

RESTORATION HARDWARE

KENT LARGE/SMALL INSET MEDICINE CABINET ASSEMBLY INSTRUCTIONS

BEFORE YOU BEGIN


Do not open cabinet door more than 90 degrees when unit is laying flat on any surface. The weight of the cabinet door opened beyond 90 degrees in a flat position may cause damage in the hinge areas. Fully open cabinet door only when in an upright position.

TOOLS AND MATERIALS REQUIRED

1. Screwdriver
2. Carpenter's level

PARTS LIST

- A. Cabinet

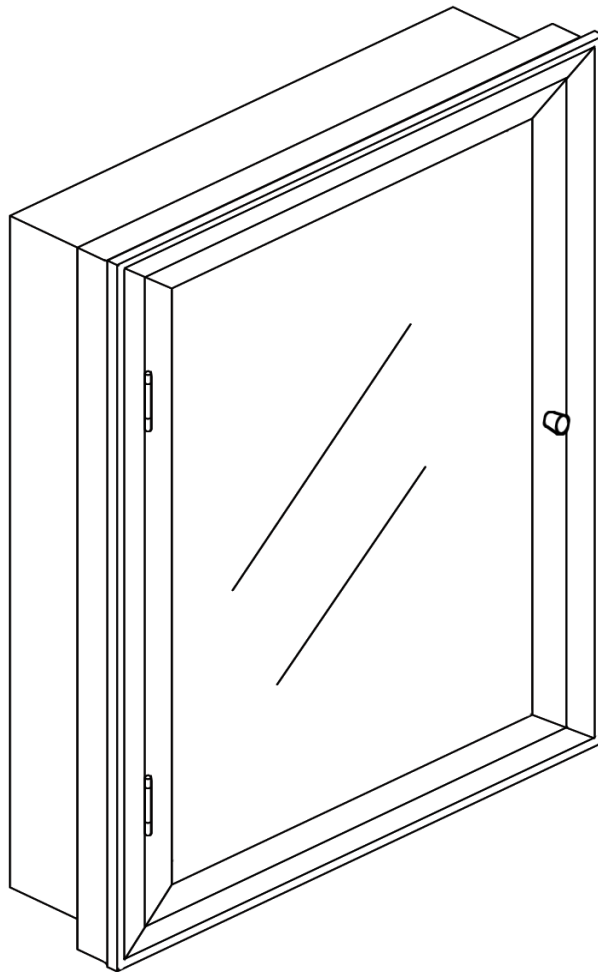

- B. Screws (x4)



RESTORATION HARDWARE

KENT LARGE/SMALL INSET MEDICINE CABINET ASSEMBLY INSTRUCTIONS

ASSEMBLY INSTRUCTIONS

1. Measure a space for the cabinet body (A). Blocking is recommended to ensure adequate support. Inset (recessed) box measurements will vary according to cabinet model (See Below).

Large size dimensions

19 1/8" wide

31 5/8" high

4 1/2" deep


Small size dimensions

14 1/8" wide

24 1/8" high

4 1/2" deep


2. Install the cabinet with recessed box set back within the wall cavity.

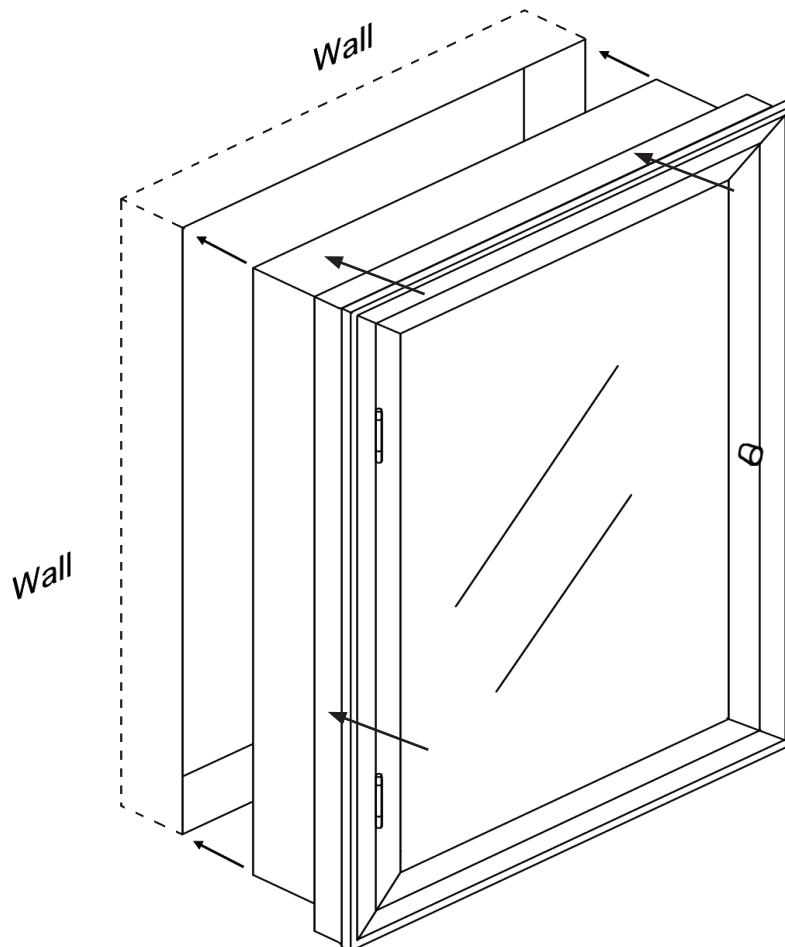

RESTORATION HARDWARE

KENT LARGE/SMALL INSET MEDICINE CABINET ASSEMBLY INSTRUCTIONS

3. Mount Cabinet by fastening the enclosed wood screws (B) on the inner side panels.
Enclosed screws to be used for installation into wood frames only.
Appropriate screws/anchors need to be purchased for installation into non-wood frames.

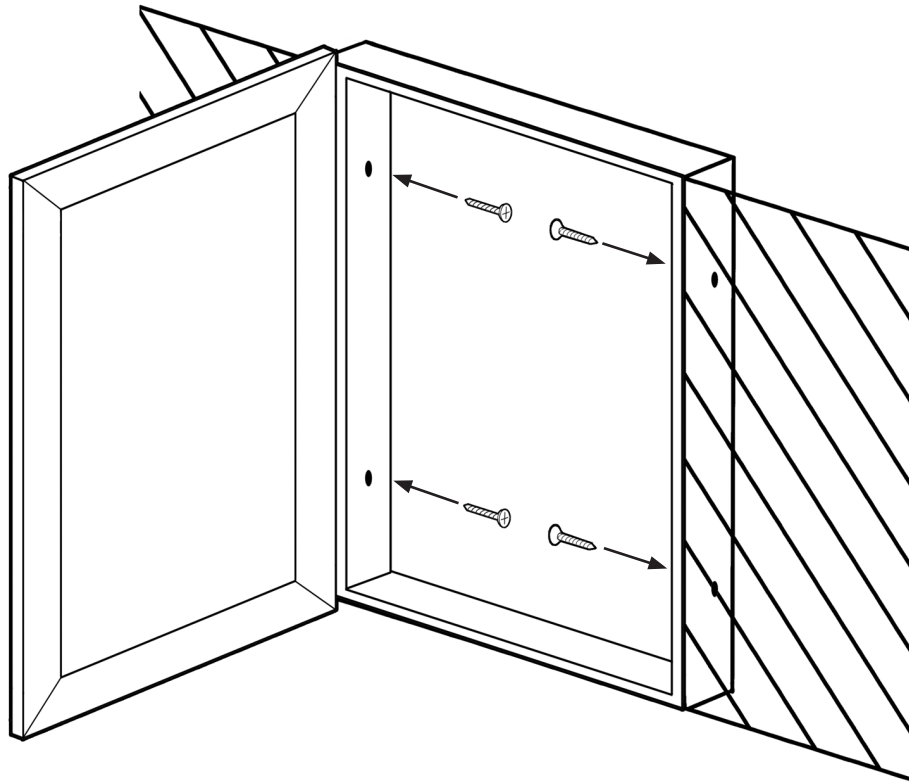

CLEANING AND MAINTENANCE INSTRUCTIONS

To maintain and protect luster of all products, clean with soft, damp cloth only.